

Range (ms)	< 350	350-370	370-390	390-410	410-430	430-450	450-470	470-490	490-510	> 510
QTc	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	100.00%
QT	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	25.00%	75.00%

Validated QTc Analysis: (60-90 bpm)

<= 450 ms 0.00% N


> 450 ms 100.00% ABN

> 490 ms 100.00% ABN+

Max QTc @ 16:12 581 ms

Max QT @ 16:04 562 ms

Normal Range QTc: 350 to 450 ms

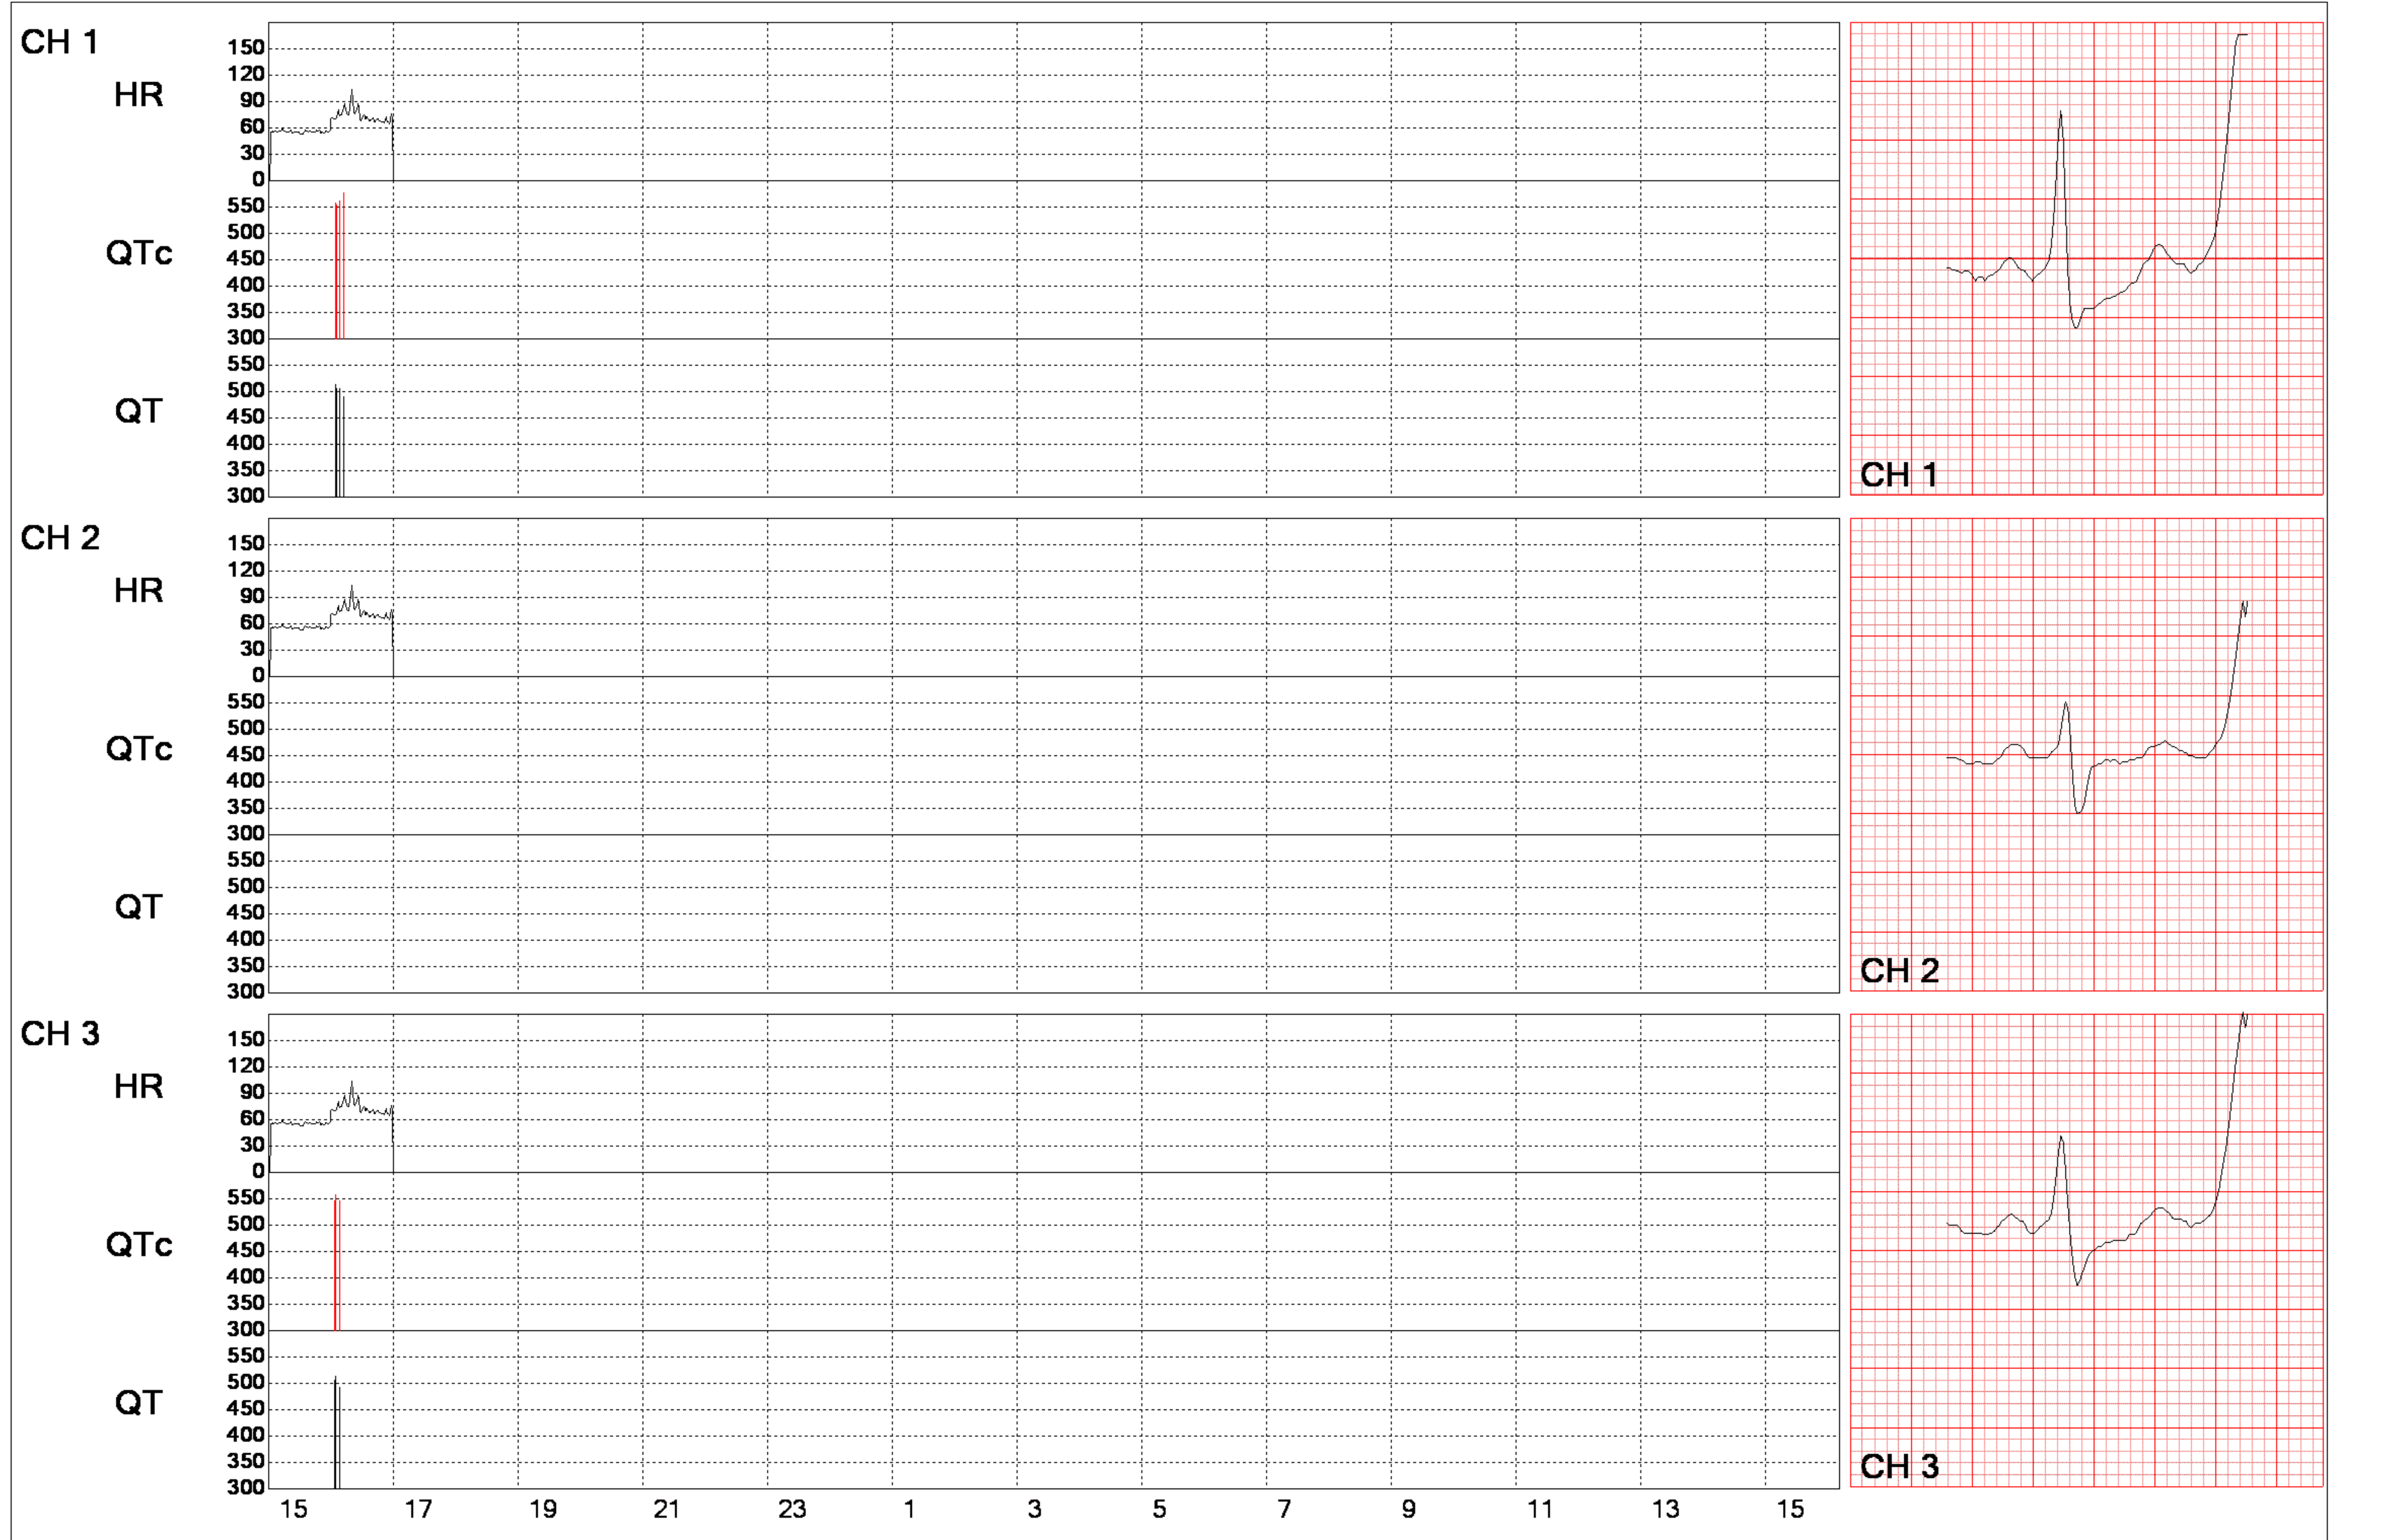

Comments

Physician Signature: _____